


NOTES:

1. MINIMUM DEPTH OF BURY 5' - 6' FROM FINISHED GRADE TO TOP OF PIPE.
2. PROVIDE POLYETHYLENE BOND BREAKER BETWEEN ALL PIPE FITTINGS AND POURED CONCRETE.
3. ALL PIPE CONNECTIONS OUTSIDE OF BUILDING FOOTPRINT SHALL BE RESTRAINED ACCORDING TO CITY OF GREELEY WATER & SEWER SPECIFICATIONS, LATEST REVISION.
4. ALL PIPE CONNECTIONS INSIDE BUILDING FOOTPRINT SHALL BE RESTRAINED & INSTALLED ACCORDING TO CITY OF GREELEY ADOPTED BUILDING CODE, LATEST REVISION.

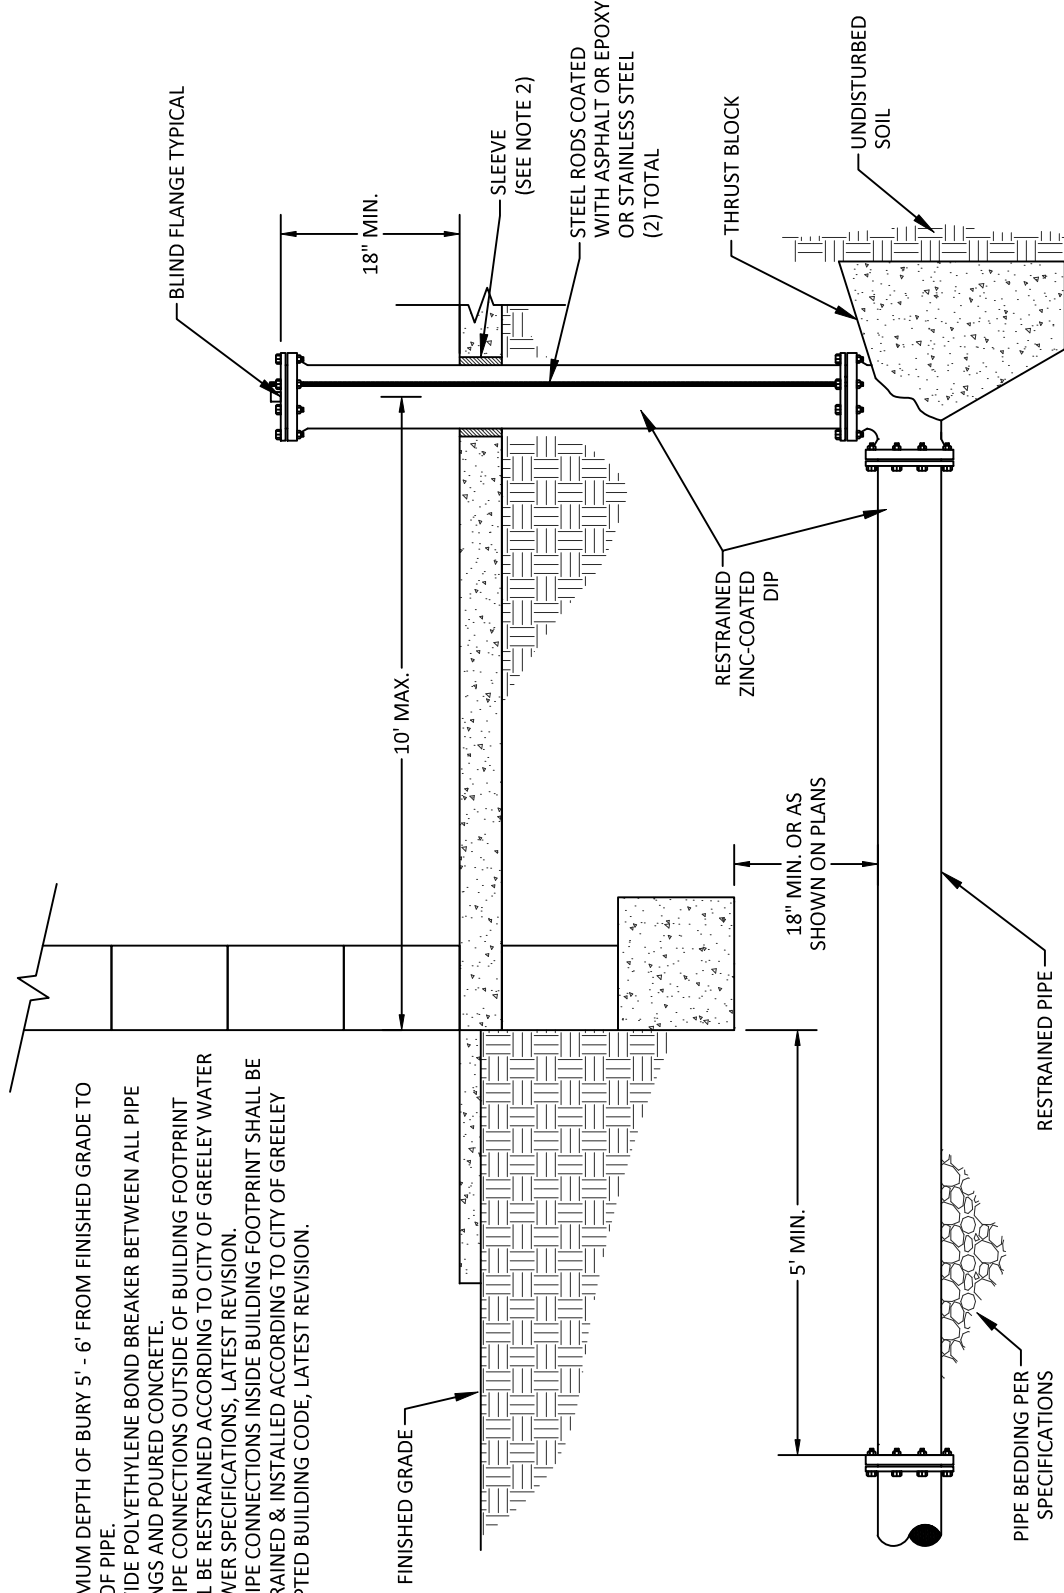

FIRE RISER INSTALLATION

DETAIL W-18



DATE: JANUARY 2023

SCALE: N.T.S.